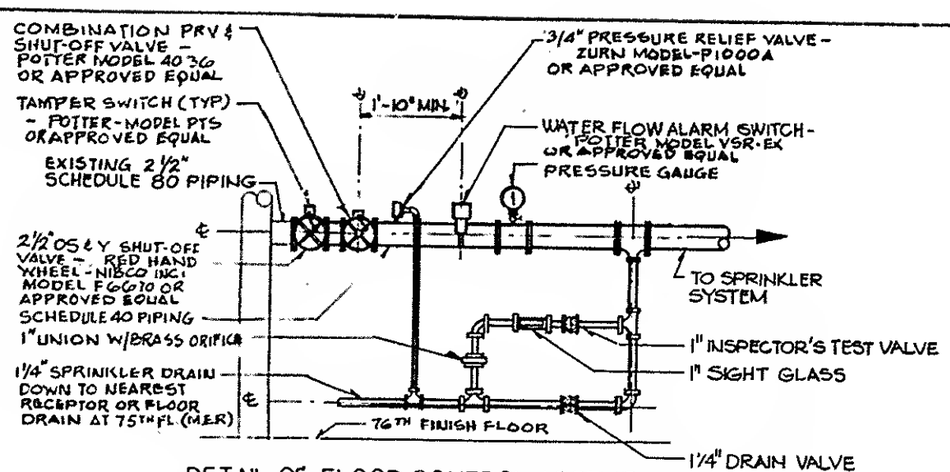

DETAIL OF FLOOR CONTROL ASSEMBLY
N.T.S

NOTE:

COMBINATION PRESSURE REDUCING VALVE AND SHUT-OFF VALVE TO BE SET AT A NO FLOW OUTLET PRESSURE OF 125 PSI. THE RESIDUAL PRESSURE AT THE OUTLET WILL VARY WITH THE TOTAL QUANTITY OF WATER CALCULATED TO FLOW THRU THE VALVE, THE AVAILABLE RESIDUAL PRESSURE MUST BE EQUAL OR EXCEED THE PRESSURE REQUIRED TO DELIVER THE CALCULATED QUANTITY OF WATER.

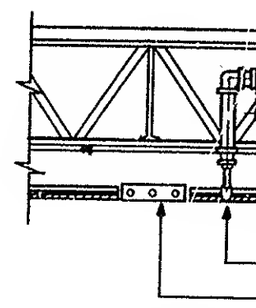

DETAIL OF TYPICAL P

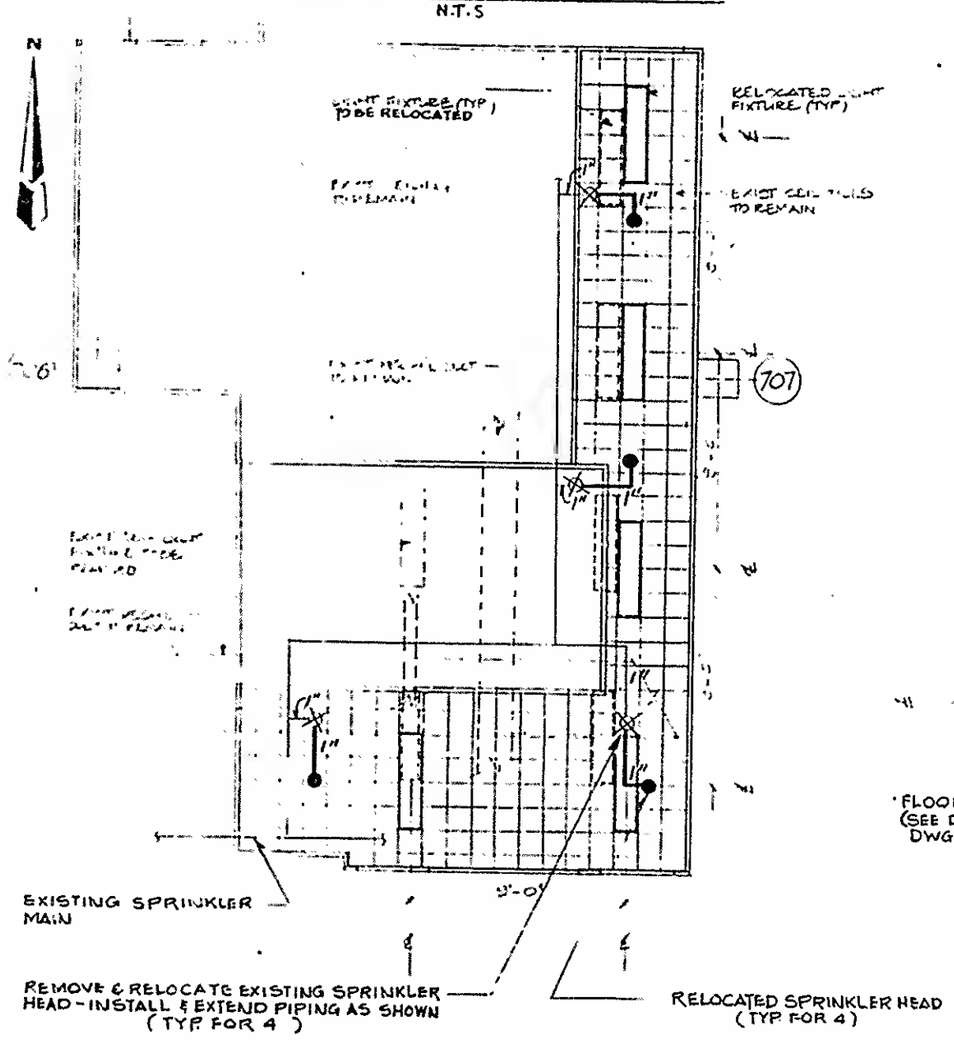

PART REFLECTED CEILING PLAN AT 75th FLOOR

SCALE IN FEET

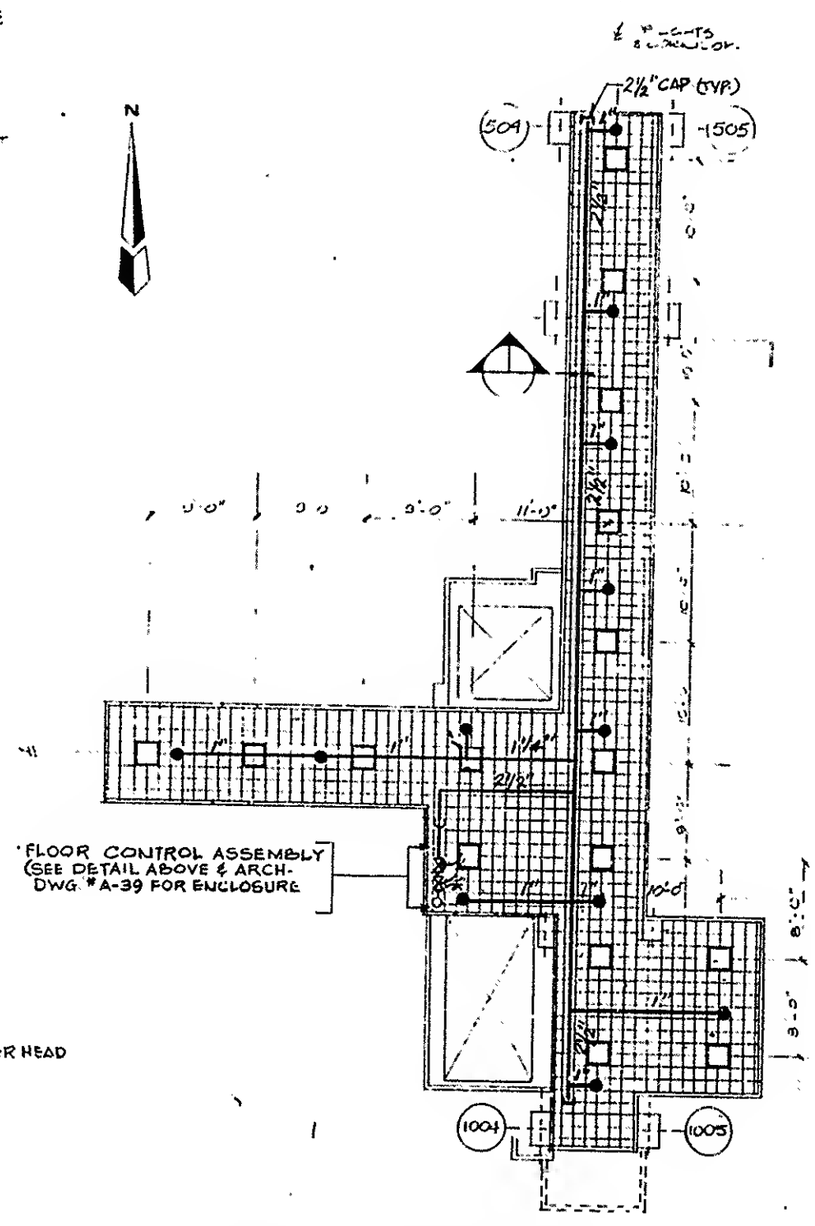

REFLECTED CEILING PLAN AT 76th FLOOR TOWER ONE

SCALE IN FEET

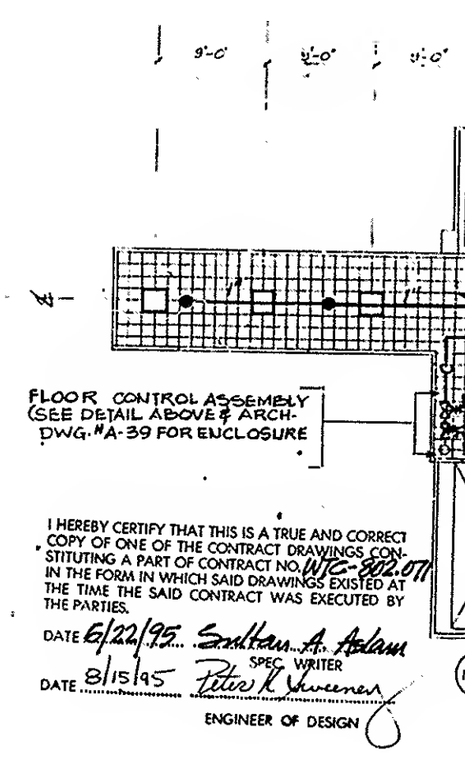

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. WTC-802.077 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE 6/22/95 Sultan A. Aslam
SPEC. WRITER

DATE 8/15/95 Peter K. Schweiner
ENGINEER OF DESIGN

REFLECTED CEILIN AT 76th FLOOR TO

SCALE IN FEET